

SPECIFICATIONS

Bur On Concrete Plank Deck

General

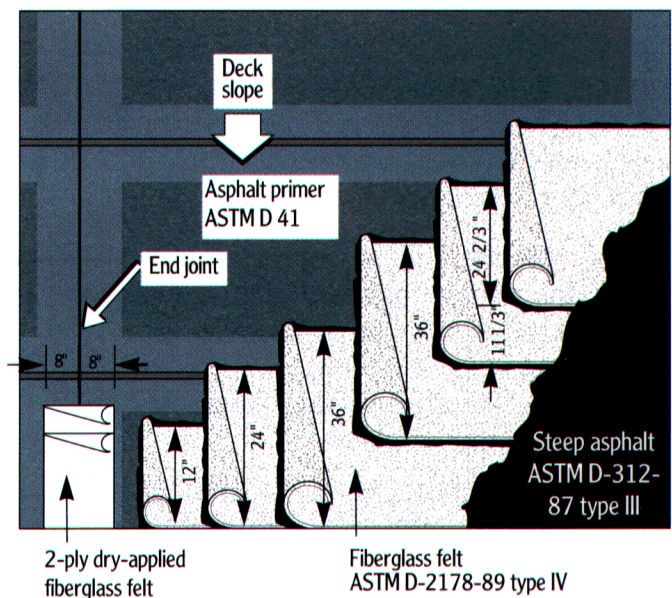
On non nailable decks, a 3-ply membrane constructed with fiberglass felts is mopped to the deck in shingle fashion. This is covered with Lightguard Ballasted Roof Insulation. All installations of the Lightguard system must be in accordance with current specifications approved by T. Clear, installed by a T. Clear approved contractor, and will be covered by a warranty from Clear.

Deck Condition

The erection and design properties for performance of the deck are not the responsibility of T. Clear Corporation and should be in accordance with applicable regulatory agency requirements and industry standards.

The deck units shall be tightly butted to adjacent units and shall be properly attached and aligned. All side joints between planks shall be key grouted to prevent differential movement and to compensate for misalignment (max 1/2"). Camber differential between adjacent tees of more than 1/4" must be corrected before roofing by placing grout between the adjacent members on a slope of 1 inch per foot feathered out onto the low tee. Grout installation should be smooth without ridges or irregularities. The deck units shall be directly welded to adjacent units. The deck surface must be dry and smooth.

If filler materials are added above the structural deck system, a 2-ply, 18" wide slip sheet ASTM D 2170-89, type IV is required at the end of each abutment of the concrete tees. This slip sheet is installed over the filler materials.

**Deck Slope Requirements**

Roofs must be designed and constructed to drain water within 48 hours after a rain. A 1/4" per foot slope is recommended. "Dead level" decks of this construction are acceptable with a sufficient number of correctly placed drains. Where a negative slope exists, consideration may be given to increasing the thickness of the insulation over the membrane to displace water. The drain body must be recessed into the deck so that the clamping ring is flush with or below the deck surface. Sumps are recommended.

The maximum slope that will be covered by Lightguard roof insulation systems is 2 inches per foot and requires the use of ASTM D 312-89, type III asphalt. (Note: Type III asphalt is

the preferred asphalt for all slopes.) ASTM D 312-89, type II asphalt may be used for slopes not to exceed 1 inch per foot. ASTM D 312-89, type I may be used for slopes not to exceed 1/2" per foot when covered with a minimum 6 mil polyethylene sheet to completely cover the asphalt so as not to come in contact with the Lightguard panel.

Built-Up Roof Installation

Sweep the deck free of dust and debris. Prime the concrete surface with asphalt concrete primer (ASTM D41-78) at a rate of one gallon per square. Allow the primer to dry to the touch before continuing with the application of the built-up roof.

Starting at the low point of the roof, if the deck is sloped, uniformly mop the primed surface with steep asphalt (ASTM D-312, type III) at the rate of 25-30 lb. per square. While hot, embed three plies of fiberglass felt (ASTM D-2178, type IV) in shingle fashion, lapping each sheet 24 2/3".

Interply moppings shall be continuous. Complete embedment of felts is required and accomplished by dragging a broom or squeegee over the felt, no more pressure is required than that exerted by the weight of the "brooming" utensil. During cold weather, effective brooming is essential to eliminate voids and to assure adhesion.

As the work progresses, full mop the surface of the membrane using a minimum coverage of 25-30 pounds per square of ASTM D-312, type III asphalt. Felt should never be exposed overnight or in inclement weather. Bitumen temperature at the kettle shall be controlled so as to not exceed the bitumen manufacturer's recommendations.

It is not acceptable to include any temporary membrane as a part of a completed membrane. Install completed membrane in final form on a day-to-day basis. If the slope of the deck is such that water might flow under the fastened fiberglass felt, temporary water cut-offs are necessary at the end of the workday. Water cut-offs must be removed prior to continuing the membrane application.

Flashing Installation

Flashings should be of granule surfaced modified bitumen sheet adhered with ASTM D 312-89, type III asphalt or torch applied. All flashing must be completed in each area prior to installing Lightguard Ballasted Roof Insulation. Conform to details shown in architectural drawings, and install according to T. Clear flashing specifications. Non granule surfaced modified bitumen sheets may be used but require periodic maintenance due to weathering that is not included in the T. Clear warranty.

Other Relevant T. Clear Specifications

For installation of Lightguard Ballasted Roof Insulation panels, see:

1. Lightguard installation, wind design, and securement specifications (LIDS 1993)
2. Lightguard flashing details (LFD 1993)
3. Lightguard roofing specifications for coal tar pitch bitumen membranes (CTPM 1993)

Fire Classification Information For Lightguard Roof Assemblies

1. All Lightguard assemblies are considered as ballasted systems with respect to Factory Mutual (F.M.). Refer to the current F.M. data sheet 1-29.
2. All Lightguard roof assemblies are rated Class A. (fire from without). Obtain specific configuration details from Underwriter's Laboratory (U.L.) from the current roofing materials and Systems Directory.
3. For information on hourly rated constructions (fire from within) see the current U.L. Fire Resistance Directory.



P.O. Box 416
Hamilton, Ohio 45012
1-800-544-7398

NOTICE: T. CLEAR CORP. believes the information and recommendations herein to be accurate and reliable as of November 1990. However, since any assistance furnished by T. CLEAR CORP. with reference to the proper use and disposal of its products is provided without charge, and since use conditions and disposal are not within its control, T. CLEAR CORP. assumes no obligation or liability for such assistance and does not guarantee results from use of such products or other information herein; no warranty, express or implied, is given nor is freedom from any patent owned by T. CLEAR CORP. or others to be inferred. Information herein concerning laws and regulations is based on U. S. federal laws and regulations except where specific reference is made to those of other jurisdictions. Since use conditions and governmental regulations may differ from one location to another and may change with time, it is the Buyer's responsibility to determine whether T. CLEAR CORP.'s products are appropriate for Buyer's use, and to assure Buyer's workplace and disposal practices are in compliance with laws, regulations, ordinances, and other governmental enactments applicable in the jurisdiction(s) having authority over Buyer's operations.